

- ☒ **IMPROVEMENT PERMIT** (Valid for 60 months from date of issue) (Building permit cannot be issued unless CA is marked)
- ☒ **CONSTRUCTION AUTHORIZATION** (Expires with Improvement Permit on: **10/1/2031**)
- ☐ This authorization is for a/n _____ to a wastewater system.

Applicant/Owner: **John C. Campbell Folk School** PIN#: **551001464909000** Zone: **MP** Acreage: **7.40**

Property Description: **Rockhouse Rd.**

Facility: **Residential, 8 bedrooms** Maximum # Occupants: **16** Basement: **No**

Design Flow: **960 gpd** Water Supply: **Existing Shared Well** (on-site)

IMPROVEMENT PERMIT

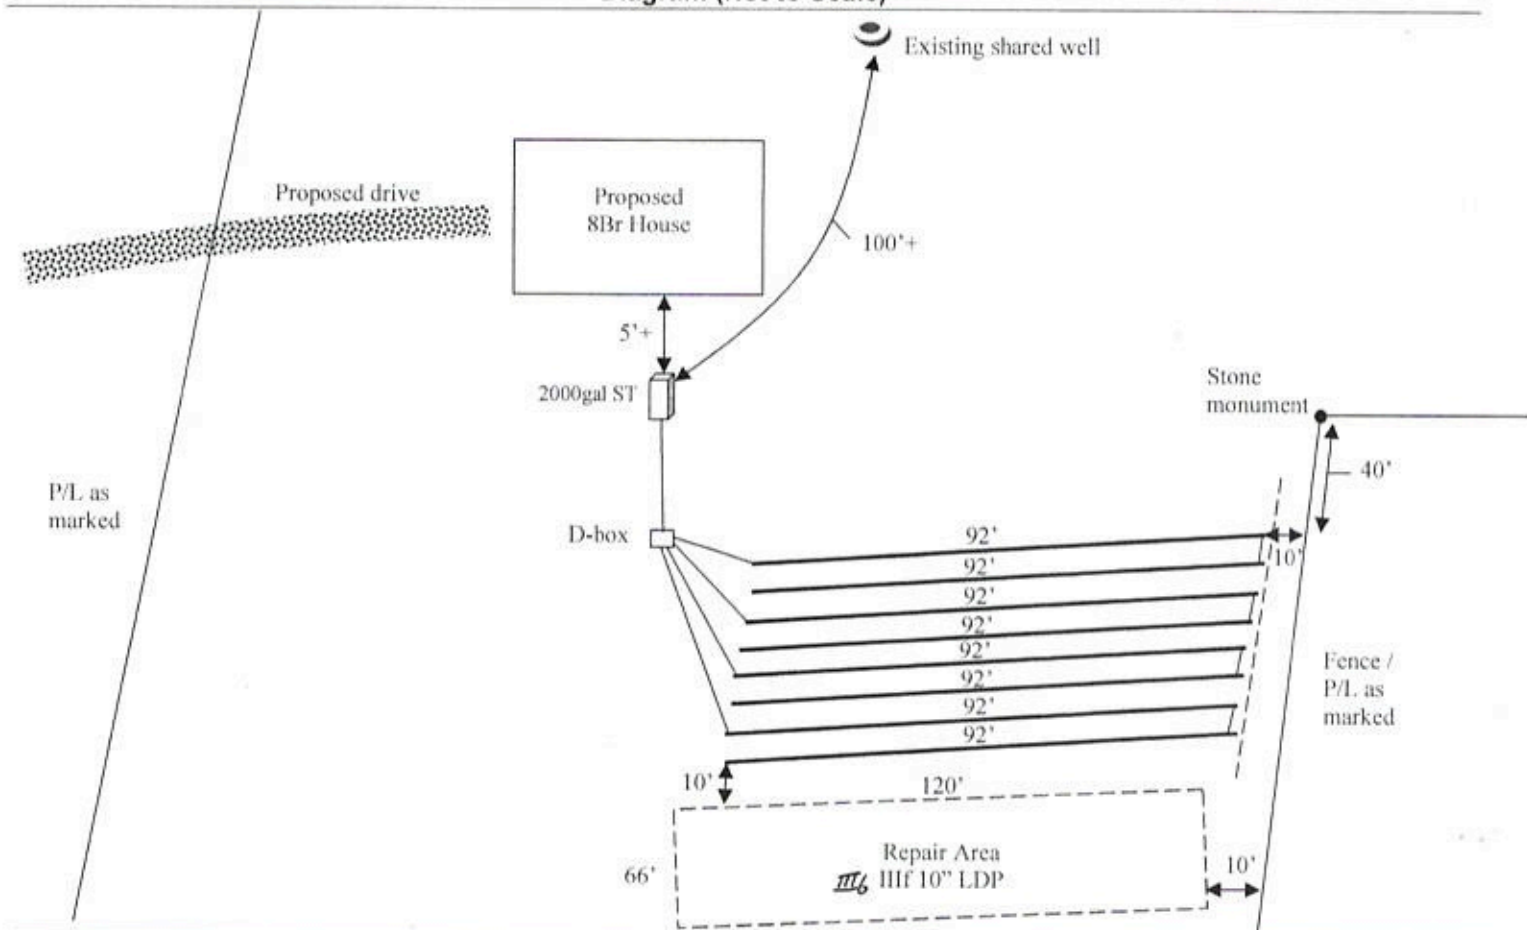
System: **25% Red. - Gravity** Class: **Ib**
 Soil Depth: **37"** Saprolite: **0** LTAR: **0.33** Slope: **14%**
 Repair: **LDP-10 - Gravity** Class: **III f III 6**
 Repair Soil Depth: **34"** LTAR: **0.33**

CONSTRUCTION AUTHORIZATION

Septic Tank: **2000 gal** Pump Tank: **Not Req'd**
 Trench Length: **736'** & Spacing: **9' Min** (On Center)
 Trench Depth: **18" Max** (Low Side) & Width: **36" Max**
 Distribution: **Equal**

Permit Conditions:

Do not disturb designated system areas. Divert all drainage from system areas. Maintain all setbacks. Do not bench. Installer is responsible for installing lines level and on contour.

Diagram (Not to Scale)

This permit/authorization is subject to revocation if the information submitted in the application is found to have been incorrect, falsified or changed, the site is altered, or intended use changes; is transferable; and is subject to the provisions of the Laws and Rules for Sewage System Collection, Treatment, and Disposal of the North Carolina Administrative Code. (By signing this document, I accept the specifications of this permit)

Date: **10/5/26**

Issue Date: **10/1/2026**

Parker Caldwell, REHSI 3420

Owner/Legal Reps. Signature

Authorized State Agent